




**FIRE INSPIRED®**

**Hearth Products Controls Co**  
**CSA CERTIFIED-OUTDOOR USE ONLY**  
**FOR COMMERCIAL AND RESIDENTIAL USE**



**HEARTH PRODUCTS CONTROLS**  
**2225 LYONS RD.**  
**MIAMISBURG, OH 45342**  
**TOLL FREE: 877.585.9800**  
**PHONE: 937.436.9800**  
**www.hpcfire.com**

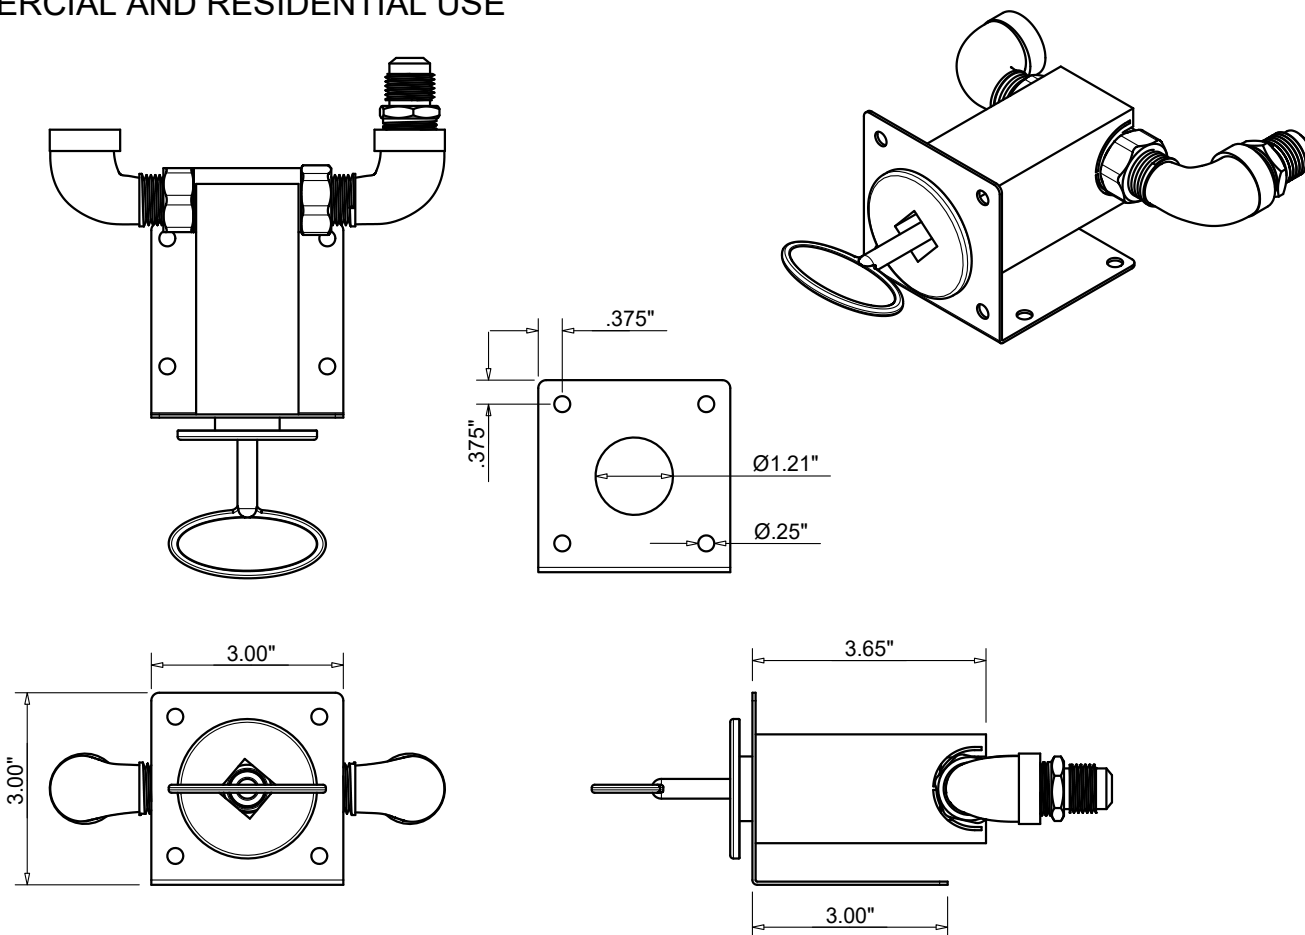

**NOTES:**

**BRACKET MATERIAL: 304 STAINLESS STEEL**

**1. PROPER VENTING**

• **ENCLOSURES:**

- For Fire Pit Inserts upto 200K BTU: Required 2 vents, 18 sq.in. each on opposing sides.
- For Fire Pit Inserts 200K to 400K BTU: Required 4 vents, 18 sq.in. each on opposing sides.

- **BOWLS (Copper, concrete or metal)** - Bowl to be raised above mounting surface minimum of 3/4" gap;  
 Bowl to have a minimum of 6" diameter hole in bottom

**2. GAS SUPPLY**

- Natural Gas: Supply Pressure: Minimum: 3.5" W.C.; Maximum: 7.0" W.C.
- LP Gas: Supply Pressure: Minimum: 8.0" W.C.; Maximum 11.0" W.C.

**IMPORTANT:** Ensure any flex line that may be used from the permanent main fuel supply to the product is rated to the stated max btu of the product and certified to ANSI Z21.75\*CSA 6.27.

**3. MODIFICATION OF PRODUCT WILL VOID ANY CERTIFICATION AND WARRANTY.**


**4. FOLLOW ALL MANUFACTURER INSTALLATION INSTRUCTIONS AND LOCAL CODES.**

**5. ALL DIMENSIONS ARE CONSIDERED TRUE AND REFLECT MANUFACTURER'S SPECIFICATIONS AS OF THE REVISION DATE.**

**6. DO NOT SCALE DRAWING.**

**7. THESE DRAWINGS ARE FOR SIZING AND PLANNING PURPOSES. ALL INFORMATION CONTAINED HEREIN WAS CURRENT AT THE TIME OF DEVELOPMENT. THE MANUFACTURER'S RESPONSIBLE FOR THE ACCURACY OF THE DRAWING.**

**8. CONTRACTOR'S NOTE: FOR PRODUCT AND COMPANY INFORMATION VISIT [www.CADdetails.com/info](http://www.CADdetails.com/info) REFERENCE NUMBER 771-074.**



**MATCH LIT**

**MATCH LIT VALVE ASSEMBLY**